


NOTE: SHORTING BLOCK JP10 MUST BE IN PLACE AS SHOWN TO ENSURE PROPER OPERATION. (NOT PRESENT ON "ULM" (REV I) BOARDS.

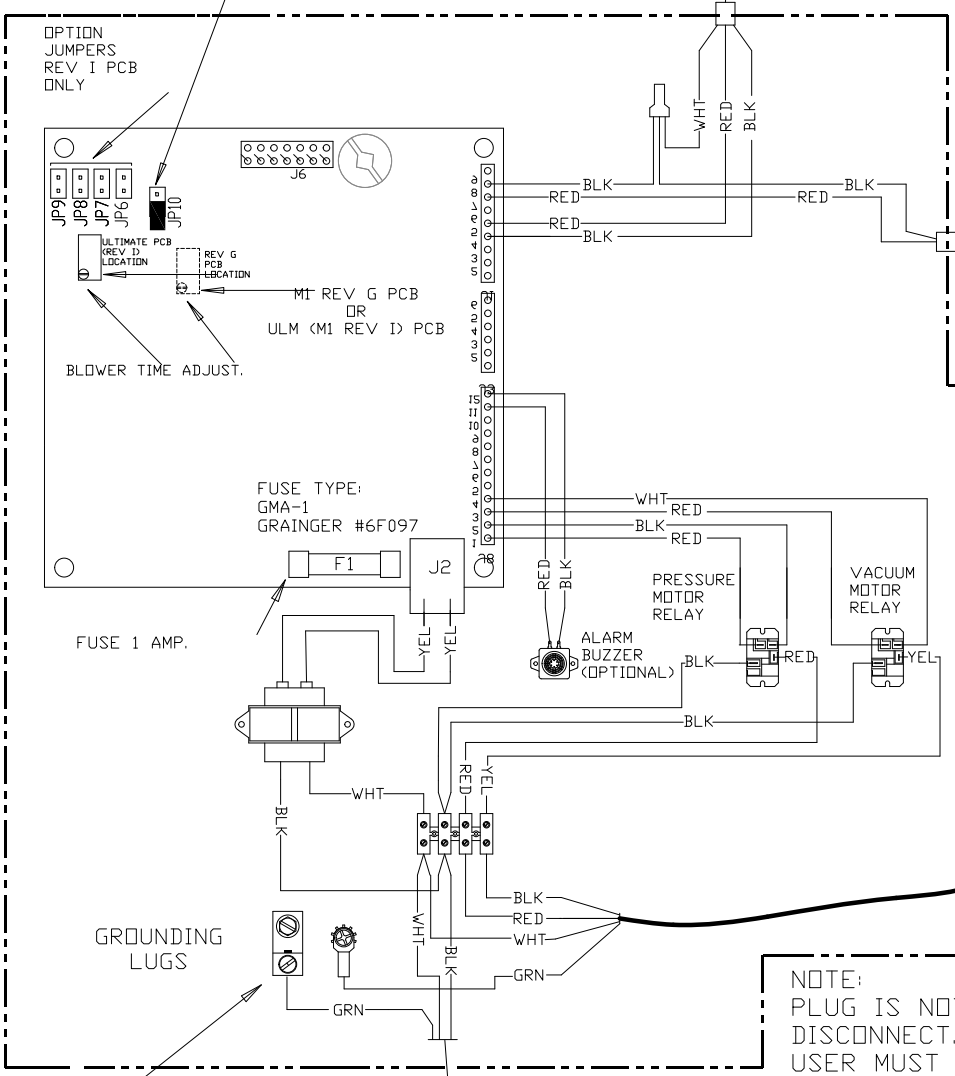

TO SECURE GROUND LUGS TO FRAME USE #10 SHEET METAL SCREW. USE UL LISTED GROUND LUG.

NOTE: PLUG IS NOT SUITABLE AS A DISCONNECT. USER MUST SUPPLY A SUITABLE DISCONNECT.

VOLTAGE-120VAC  
14 AMPS  
1 HP SINGLE PHASE/50/60 Hz.

20 AMP BRANCH CIRCUIT PROTECTION TO BE PROVIDED BY OTHERS DURING FIELD INSTALLATION.



INFORMATION CONTAINED HEREIN IS PROPRIETARY TO EAGLE PNEUMATIC, INC ALL RIGHTS RESERVED.

TOLERANCES: UNLESS OTHERWISE SPECIFIED FRACTIONS +/-1/32" DECIMALS +/-0.005"

REVISIONS: 1.-11/27/02 2.-12/17/02 3.-04/10/03 4.-10/25/06 5.-02/21/13 6.-11/07/13

DRAWN BY: JAC

DATE:11/26/02

NAME: WIRING DIAGRAM MINI MARK II TICKET DELIVERY SYSTEM 3 OR 4 INCH

PART NO.

E-11899

CADFILE: A20